



Karnataka Fire and Emergency Services Department

Office of the District fire officer,
Tumkur Fire station
BH Road, Tumkur – 572 103.
Ph No.0816 – 2283101.



No.40/CC/DFO/TFS/2026.

Date:19-02-2026.

To,
The Authorized Signatory.
M/s. Radhaananda Public School,
Bukkapattana Road,
Sira,
Tumkur Dist-572137.

Sir

Sub: Renewal of “**Compliance report**” with respect to fire prevention, fire fighting and evacuation measures Provided & maintained at **M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.**

Ref: 1. Fire Safety Recommendation C.No.28/FSR/DFO/TFS/2025. Dt:-28/02/2025.
2. Compliance Report No.28/CC/DFO/TFS/2025, Dt:28/02/2025.
3. Your letter dated 15-02-2026.

* * * * *


With reference to subject above cited, a ‘Fire Safety Recommendation’ was issued wide reference (1) to the premises of **M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.** with a condition to fulfill the recommendations and compliance the same within 3 months.

As per reference cited (2) above Fire Safety Compliance Certificate was issued for above school premises.


With reference cited (3) above, the applicant has requested to this office for renewal **Compliance Certificate**, In this regard, I was re-inspected the premises of **M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.** on **19.02.2026** for Renewal of Compliance Certificate. the management of School was complied the all recommendation communicated in Fire Safety Recommendation.

Under the above circumstances the Karnataka Fire & Emergency Services Department is issuing the ‘**Renewal Fire Safety Compliance Certificate**’ to **M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.** subject to proper maintenance of firefighting systems In good working condition. **And At least 40% of employees should be trained in basic firefighting course at our R.A.Mundkur Fire and Emergency Services Training Academy, Bannerghatta Road, Bangalore-29**

This Fire Safety Compliance Certificate was issued for only **Two years** from the date of issue and it is renewable.

Yours faithfully

District Fire Officer
Karnataka Fire & Emergency Service
Tumakuru-572 103


PRINCIPAL
RADHAANANDA PUBLIC SCHOOL
BUKKAPATNA ROAD, SIRA - 572137

For Shivanagere Education Trust

Secretary



Karnataka Fire and Emergency Services Department

Office of the District fire officer,

Tumkur Fire station

BH Road, Tumkur – 572 103.

Ph No.0816 – 2283101.



No.28/CC/DFO/TFS/2025.

Date:28-02-2025.

To,
The Authorized Signatory
M/s. Radhaananda Public School,
Bukkapattana Road,
Sira,
Tumkur Dist-572137.

Sir,

Sub : Issue of “Compliance report” with respect to fire prevention, fighting and evacuation measures maintained at to **M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.**

Ref : Fire Safety Recommendation C.No.28/FSR/DFO/TFS/2025. Dt:-28/02/2025

*** **

With reference to subject above cited, ‘Fire Safety Recommendation’ was issued wide reference (1) to the premises of to **M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.** with a condition to fulfill the recommendations and compliance the same within 3 months.

The applicant has requested to this office for Issue of Compliance Certificate. In this regard I was inspected the premises on 06-02-2025 for issuing Compliance Certificate. the management to **M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.** Was compiled the all recommendation communicated in Fire Safety Recommendation except training part.

Under the above circumstances the Karnataka Fire & Emergency Services Department is issuing the ‘Fire Safety Compliance Certificate’ to to **M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.** Subject to proper maintenance of firefighting systems In good working condition. And At least 40% of employees should be trained in basic firefighting course at our R.A.Mundkur Fire and Emergency Services Training Academy, Bannerghatta Road, Bangalore-29

This Fire Safety Compliance Certificate is Valid till 27-02-2026 and it is renewable.

Yours faithfully,

[Signature] 28/02/25
District Fire Officer

Karnataka Fire & Emergency Service
Tumakuru-572 103

[Signature]
PRINCIPAL

RADHAANANDA PUBLIC SCHOOL
BUKKAPATNA ROAD, SIRA - 572137

For Shivanagere Education Trust

[Signature]
Secretary



Karnataka Fire and Emergency Services Department
Office of the District fire officer,
Tumkur Fire station
BH Road, Tumkur – 572 103.
Ph No.0816 – 2283101.



No.28/FSR/DFO/TFS/2025.

28-02-2025.

To,
The Authorized Signatory
M/s. Radhaananda Public School,
Bukkapattana Road,
Sira,
Tumkur Dist-572137.

Sub: Issue of Fire safety recommendation to M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.

Ref: Your letter dated:06-02-2025.

*****_****

ANNEXURE-B

NBC-2016, Part-4, Table 7 (11) 3.1.3 Group B Educational Buildings Sub division B1 & B2.
(These condition are indicative and not exclusive all relevant provisions related to fire and life safety of NBC 2016 are mandatory)

With reference to the subject cited above, I was inspected The premises of to M/s. Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137. On 06-02-2025 with respect to Fire prevention, Firefighting and Evacuation measures to be complied in the premises and has submitted the details as under:

A. Details of the building / premises :-

01	Name and Address of the Applicant.	:	Authorized Signatory, <u>M/s. Radhaananda Public School,</u> Bukkapattana Road, Sira, Tumkur Dist-572137.
02	Name and Address of the premises.	:	<u>M/s. Radhaananda Public School,</u> Bukkapattana Road, Sira, Tumkur Dist-572137.
03	Name and address of the Building owner	:	<u>M/s. Radhaananda Public School,</u> Bukkapattana Road, Sira, Tumkur Dist-572137.

PRINCIPAL

RADHAANANDA PUBLIC SCHOOL
BUKKAPATTANA ROAD, SIRA - 572137

For Shivanagere Education Trust

Secretary

04	Number of buildings	:	01 Block.
05	Number of floors:-	:	Ground floor and 03 upper floors.
<u>Floor-wise details of occupancy:-</u>			
06	Ground floor	:	Class rooms, Office rooms, Wash Rooms, Staff Room
	1 st floor	:	Class rooms.
	2 nd Floor	:	Class rooms.
	3 rd Floor	:	Class rooms.
07	Height of the buildings:-	:	14.90 Mtrs
08	Site area	:	01-28 Acers
Built-up area of each floor:-			
09.	Ground floor	:	1424.90 Sq.Mtrs
	1 st floor	:	1424.90 Sq.Mtrs
	2 nd Floor	:	1424.90 Sq.Mtrs
	3 rd Floor	:	1424.90 Sq.Mtrs
10.	Total built-up area	:	5699.60 Sq.Mtrs
<u>Surrounding properties:-</u>			
11.	East (Front)	:	12.00 Mtrs wide Sira To Bukkapattana Road
	West (Rear)	:	Oil Mill
	North (Side)	:	Transformer Industries
	South (Side)	:	Vacant Land
<u>Set-back area available around the building :-</u>			
12.	East (Front)	:	06.00 Mtrs.
	West (Rear)	:	NIL
	North (Side)	:	06.00 Mtrs.
	South (Side)	:	07.00 Mtrs.

A. On inspection of this Educational premises, the following fire prevention, firefighting and evacuation measures recommended are considered absolutely essential from fire safety point of view :-

Sl. No. (1)	Details (02)	Existing (03)	Recommendations (04)
01.	Accessibility to the premises	The site is accessible from 12.00 Mtrs wide Sira To Bukkapattana Road located on Eastern front side. It's hard enough to carry Fire Tender	Complied.
02.	No. of entrances	01 main entrance	Adequate.
03.	Width of entry / exit	01 entry of 06.00 Mtrs width.	Adequate.

9.	Terrace tank over respective tower terrace.	Overhead tank of 5,000 liters capacity have been provided.	Complied.
10.	At the terrace tank level with minimum pressure of 3.5 kg/cm ² .	Booster pump of capacity 450 ltrs. per minute have been Provided and its connected to the overhead tank.	Complied.
11.	No Smoking Board	COPTA Sec-4 Direction <u>No Smoking area, Smoking here is an offence</u> board should be written in English & Kannada both language have been prominently displayed at each floor	Complied.
12.	Fire siren	A fire siren has been installed in the premises to inform the inmates in the case of a fire emergency and evacuate the area.	Complied.
13.	Nominate one fire Nodal officer	The school authority has been nominated Mr. Ramesh as a fire nodal officer.	Complied.
14.	Escape routes	Direction in which the students have to move in the event of an emergency has been displayed in the corridor on each floor during evacuation	Complied.
15.	Fire order	Fire safety indicating the details of actions to be taken in case of emergency have been displayed near each staircase landings with the telephone numbers of our Sira Fire station 08135-275205, and telephone numbers of nearest Ambulance Service.	Complied.
16.	Firefighting training	Not Imparted	At least 40% of employees shall be trained in basic firefighting course at our R.A.Mundkur Fire and Emergency Services Training Academy, Bannerghatta Road, Bangalore-29 at an early Date or within 03 Months.

04.	Diesel generators.	01 generator of 12.5KVA capacity have been Provided to supply alternate power to all the emergency provision of the buildings.		Complied.
05.	No. of staircases available	Nos. of staircases	: 02 Nos.	Adequate
		Width of staircases	: 01.45 Mtrs	
		Width of treads	: 0.3 Mtrs	
		Height of risers	: 0.60 Mtrs	
		Nos. of riser per flight	: 14+9 No's	
		Height of handrails	: 01.20Mtrs	
		Head room clearance	: 02.85Mtrs	
06.	No. lifts and capacity.	Nos. of lifts	: NIL	----
		Capacity of lifts	: NIL	
07.	Fire extinguishers	40 Nos ABC fire extinguisher of 06Kgs capacity have been provided. 01No Water mist Fire extinguisher of 09Ltrs capacity has been provided Near the staircase at each floor. 01No Mechanical foam Fire extinguisher of 09Ltrs capacity has been provided Near the Generator. 01No Co2 Fire extinguisher of 4.5Kg capacity has been provided Near the Electrical Panel Board.		Complied.
08.	First aid Hose reel hose.	Hose reel hose system of 19 mm dia and having a length of 36.00 Mtrs length have been installed by tapping them to a vertical pipe of 80 mm internal dia near the landing outlets at each floor. The hose reel system have been connected to an overhead tank of 5,000 Ltrs capacity with a pump capable of delivering 450 liters of water per minute.		Complied.


PRINCIPAL

RADHAANANDA PUBLIC SCHOOL
BUKKAPATNA ROAD, SIRA - 572137


For Shivanagere Education Trust

S. R. Srinivas
Secretary

Fire precautionary measures :-


- A. Explosive and flammable materials should not be stored in the store room, UPS room, Electrical panel area, class rooms, laboratory & electrical sum panel premises.
- B. Accumulation of combustible waste in and around the premises should be avoided.
- C. The exit ways shall be always kept clear without any obstruction.
- D. Liquefied petroleum gas should not be stored in the building.
- E. The doors shall not be kept locked / latched during working hours and shall be free from obstruction.
- F. During the class hours the class room doors shall not be locked from inside to outside.
- G. As per Hon'ble supreme court order all teachers and staffs shall be trained to handle safety equipment, initiate emergency evacuation and protect their students in the event of fire and other emergency and the school shall observe the Fire Safety Day on April 14th of every year by conducting Fire Safety drills with co-ordinate with fire service department.

Under the above circumstance the Karnataka Fire & Emergency Service Department is issuing '**Fire Safety Recommendation**' to to M/s. **Radhaananda Public School, Bukkapattana Road, Sira, Tumkur Dist-572137.** subject to condition and compliance of the above recommendations in column-4 of serial - B within 3 months and compliance to the undersigned.


This '**Fire Safety Recommendation**' is issued for a period of only one year from the date of issue

♣ All requirements recommended above are as per National Building Code- 2016 Part-4 clause 3.1.3 of Fire and Life safety will have to be complied with mandatorily.

Yours faithfully,

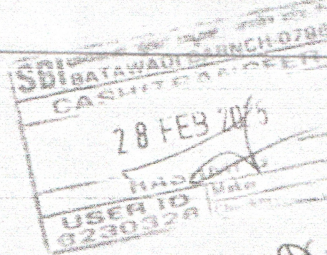

District Fire Officer
Karnataka Fire & Emergency Service
Tumakuru-572 103


PRINCIPAL
RADHAANANDA PUBLIC SCHOOL
BUKKAPATNA ROAD, SIRA - 572137

For Shivanagere Education Trust

Secretary



Challan Validity ಚಲನ್ ಜಾಲಿ ಅವಧಿ	District ಜಿಲ್ಲೆ	Department Name ಇಲಾಖಾ ಹೆಸರು	DDO Office ಡಿಡಿಒ ಕಛೇರಿ	
Challan expires On 06/03/2025	TUMAKURU	DEPARTMENT OF KARNATAKA FIRE & EMERGENCY SERVICES	DISTRICT FIRE OFFICE, TUMKUR	
Category ವರ್ಗ	Date ದಿನಾಂಕ	Challan Reference Number ಚಲನ್ ಉಲ್ಲೇಖ ಸಂಖ್ಯೆ	DDO Code ಡಿಡಿಒ ಕೋಡ್	
Government	28/2/2025	CR0225007000863541	140240	
Remitter Name ಸಂದಾಯದಾರನ ಹೆಸರು	RADHANANDA PUBLIC SCHOOL		Mobile Number ಮೊಬೈಲ್ ಸಂಖ್ಯೆ	1235458698
Address ವಿಳಾಸ	BUKKAPATTANA ROAD, SIRA, TUMKUR DIST		E-Mail ಇ-ಮೇಲ್	
Purpose ಉದ್ದೇಶ	Head of Account ಲೆಕ್ಕ ಶೀರ್ಷಿಕೆ	Sub Purpose Name ಉಪ ಉದ್ದೇಶ ಹೆಸರು	Purpose Specific ID ಉದ್ದೇಶ ನಿರ್ದಿಷ್ಟ ಐಡಿ	Amount ಮೊತ್ತ
COLLECTION OF FEES AND OTHER RECEIPTS FROM FIRE DEPARTMENT	0070-60-109-0-02-000	12.FOR ISSUE OF ADVISE ON FIRE PREVENTION AND FIRE FIGHTING FOR NON HIGH RISE BUILDINGS.	NA	22000
		Grand Total ಒಟ್ಟು ಮೊತ್ತ	22000.00	
Remittance Bank ಸಂದಾಯ ಮಾಡುವ ಬ್ಯಾಂಕ್	STATE BANK OF INDIA	Total Amount in Words ಒಟ್ಟು ಮೊತ್ತ ಅಕ್ಷರಗಳಲ್ಲಿ	Twenty Two Thousand	
Payment Status ಪಾವತಿ ಹಂತ	Payment Yet To Be Made At Agency Bank			
Payment Details ಪಾವತಿ ವಿವರಗಳು				
Payment Mode ಪಾವತಿ ವಿಧ	Cash			



Jr. 181238126